


MANAGED APPLIANCE SETUP

INSTALLATION & SETUP INSTRUCTIONS



NECESSARY ITEMS

- 1 Managed Appliance
- 2 Rack mount rails (2)
- 3 Power cords (4)
- 4 Hard drives

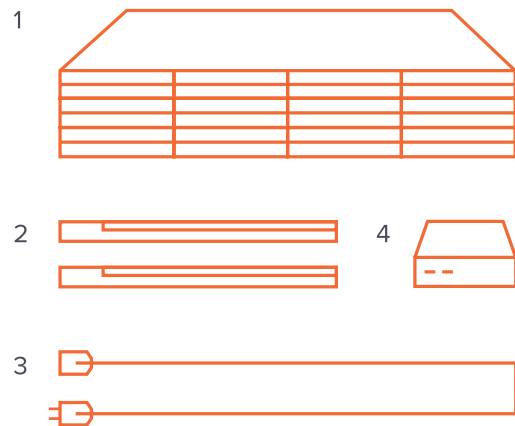


- ⓘ Hard drives are shipped separately and are in pre-mounted hot swap carriers.
- ⓘ After verifying the contents of your appliance shipment, contact your Code42 project team to set up your onsite installation. Do not complete the following steps—all equipment must be installed and configured by a certified pro services engineer.

STEP 1 RACK MOUNT INSTALLATION

- ⓘ Install the server into the rack prior to installing the drives.

- 1 Install rack rails in rack¹
- 2 Slide server or JBOD into rack on rails²

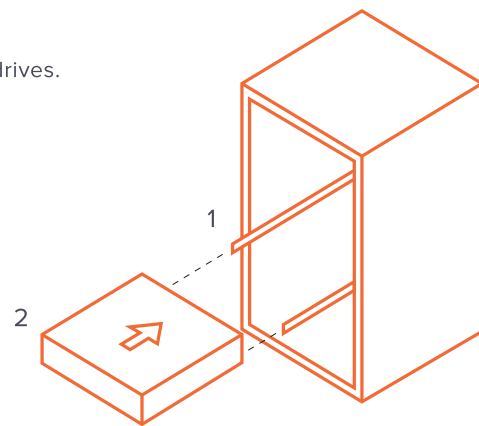


¹ SEE CHASSIS USER GUIDE VIA THE LINK ON THE BACKSIDE OF THIS GUIDE FOR DETAILED SERVER AND JBOD INSTALLATION.
² WHEN SLIDING THE SERVER INTO THE RACK, WE STRONGLY RECOMMEND HAVING A HELPER.

STEP 2 HARDWARE INSTALLATION

ⓘ Do not power on the Server or JBOD without all drives installed.

- 1 Install drives^{1,2}
- 2 Plug in keyboard, monitor (optional)
- 3 Plug in ethernet cable(s)
- 4 Plug in MGMT/IPMI cable
- 5 SAS cable port
- 6 Plug in power cords to power supplies
- 7 Power on

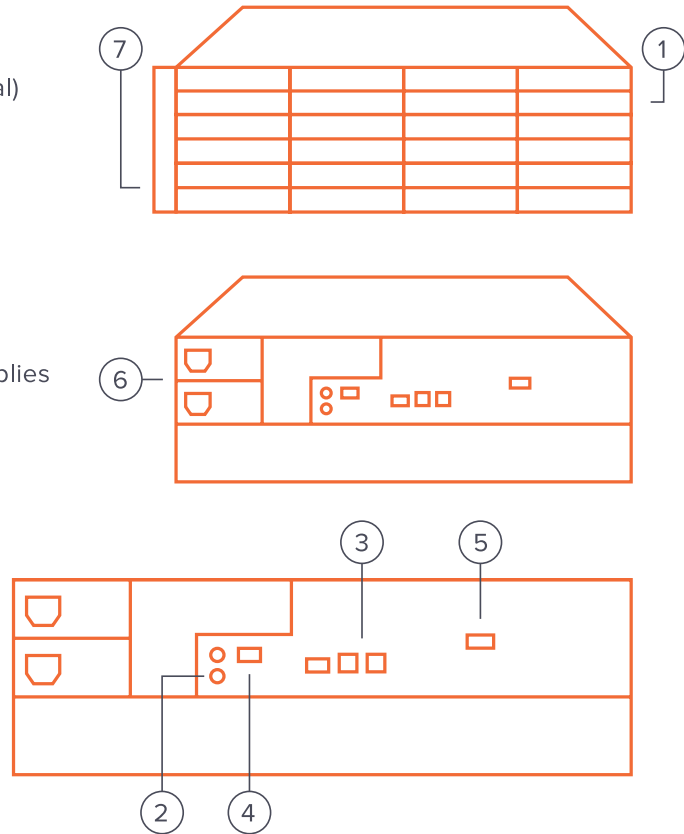

- 1 SLIDE HOT SWAP DRIVES INTO DRIVE BAYS. DRIVE SEQUENCE IS NOT IMPORTANT.
- 2 CONFIRM THAT THE SERIAL NUMBER ON THE OUTSIDE OF THE DRIVE BOX MATCHES THE SERVER/JBOD SERIAL NUMBER.

ONLINE DOCUMENTATION

<http://support.code42.com/?cid=managed-appliance-manuals>